


AirBoss with Emergency Heat Relay in Zone one. zone one.

Notes
 1. When zone one is switched to emergency heat it will energize the relay closing the contacts to the ODT.
 2. When the board receives a heat pump call it will output to the back-up heat.

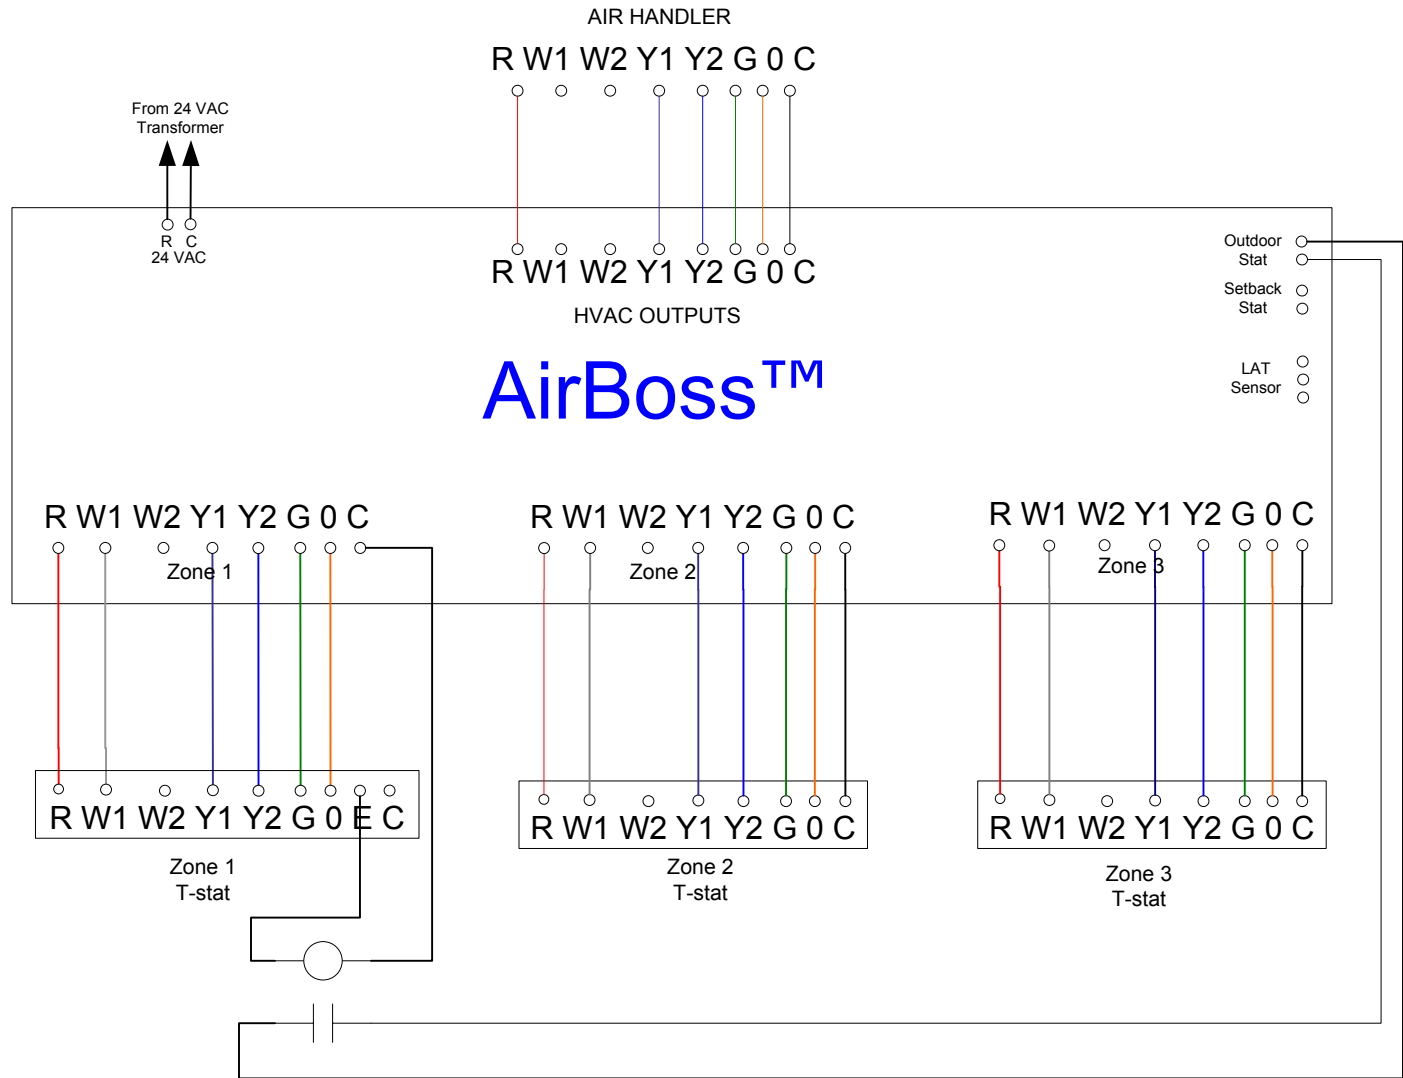

Description: Ab w/EH relay zone 1

Drawing Number:

Drawn By: WM

Date Drawn: 12/07/07

Revision Date:

Arzel Zoning Technology, Inc.
 4801 Commerce Parkway
 Cleveland, OH 4128
 Ph: 800-611-8312
 www.arzelzoning.com

