


HeatPumPro™ w/ZVI Controlling Hydronic zone valves as back-up

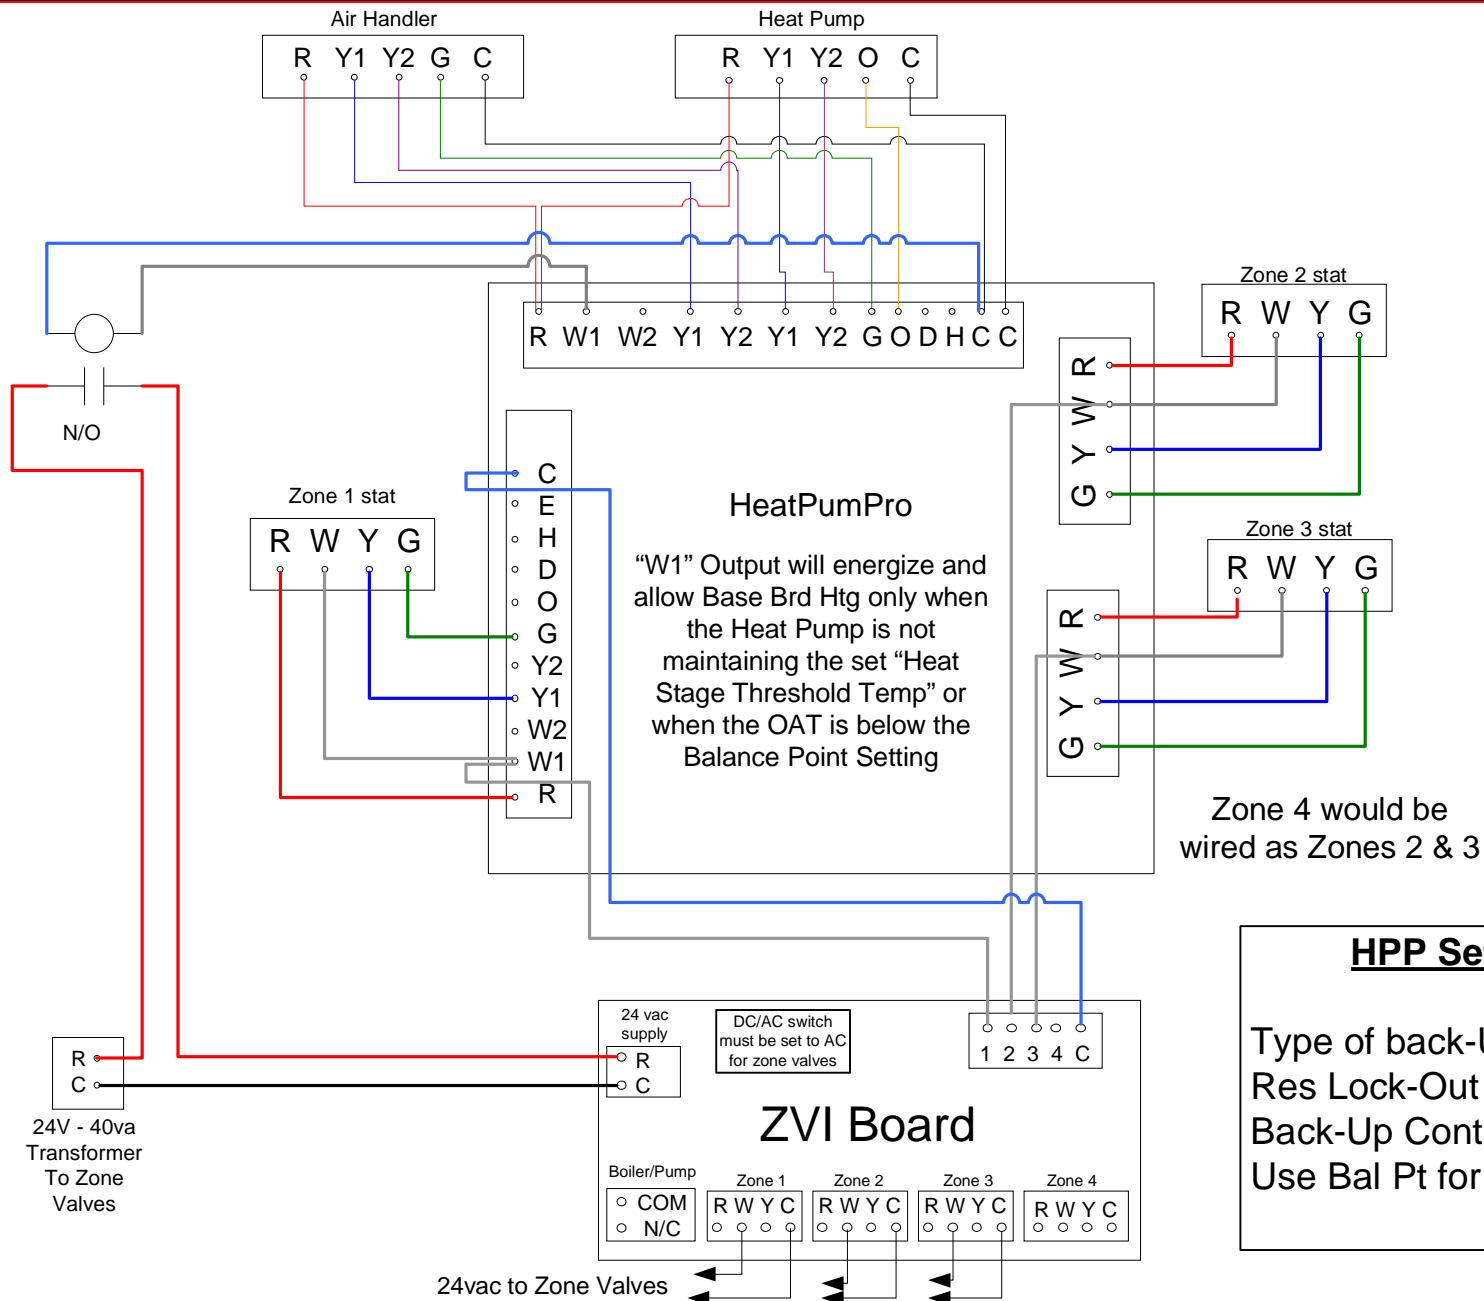

HPP Set-Up settings

Type of back-Up - "Electric"
 Res Lock-Out OAT - "Lock-In"
 Back-Up Controls Fan - "True"
 Use Bal Pt for Elect - "True"

Description: HPP w/ ZVI to Zone Valves as BP back up

Drawing Number: HPP w ZVI to Zone Valves

Drawn By: jcr Date Drawn: 1-30-13 Revision Date: _____

Arzel Zoning Technology, Inc.
 4801 Commerce Parkway
 Cleveland, OH 44128
 Ph: 800-611-8312
 www.arzelzoning.com

